





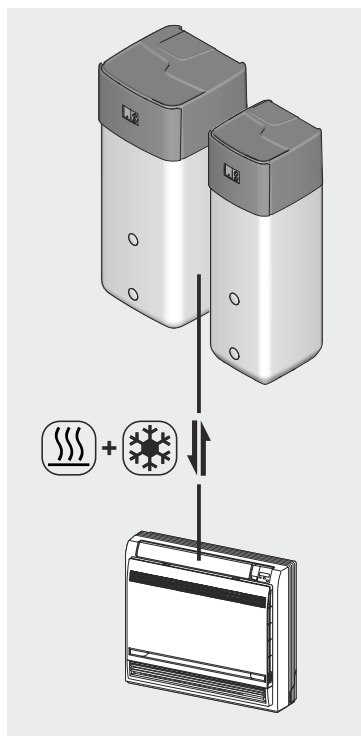


**HPSU compact V5.2
Daikin Altherma EHS(X/H)(B)
+
Heat pump convector**

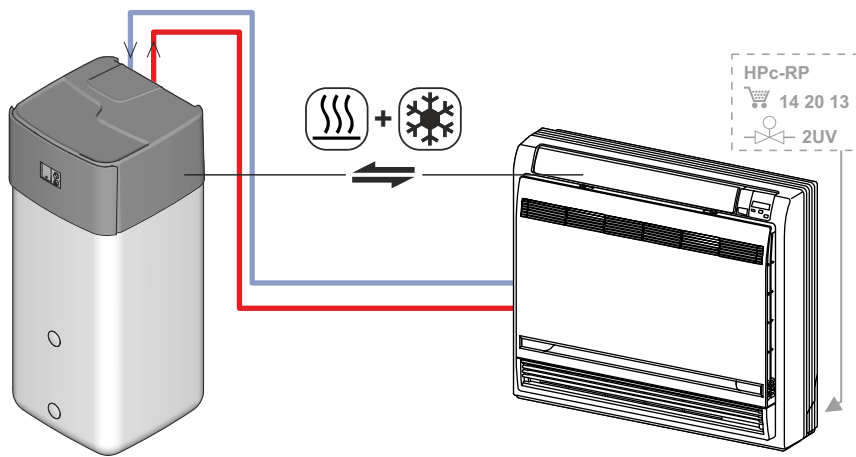

**HPSU compact V5.2
Daikin Altherma EHS(X/H)(B)**


Heat pump convector

I




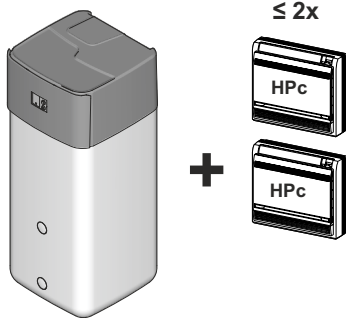



**HPSU compact V5.2
Daikin Altherma EHS(X/H)(B)**

II

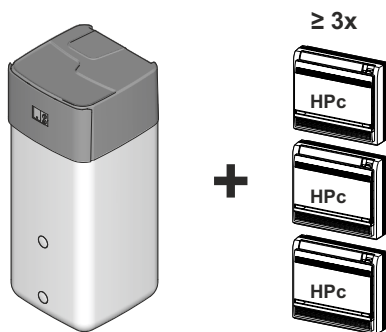

**HPSU compact V5.2
Daikin Altherma EHS(X/H)(B)**

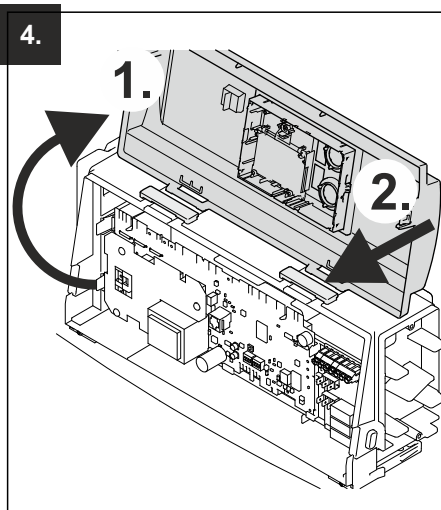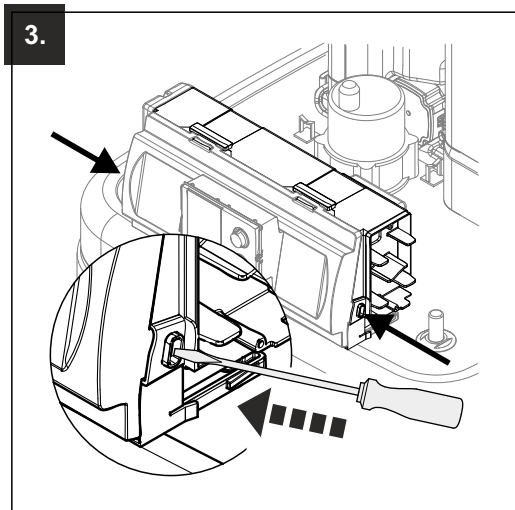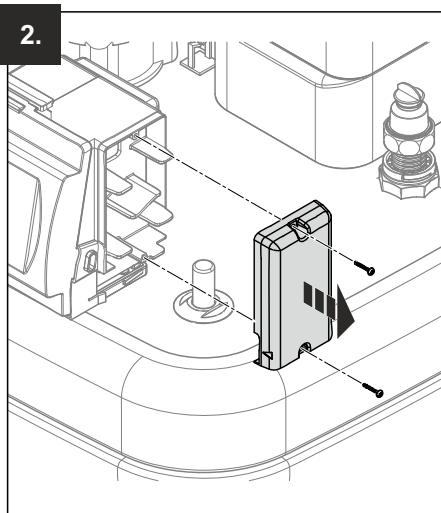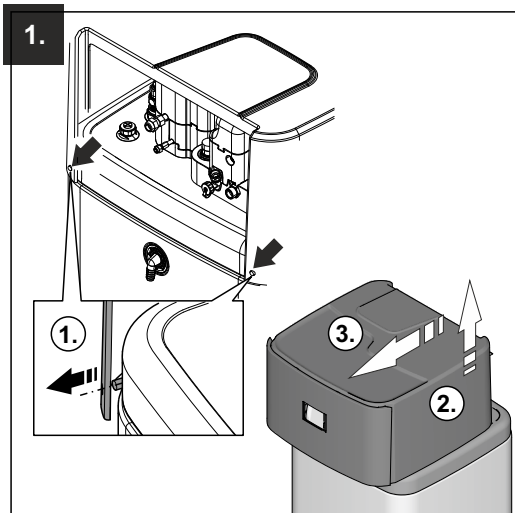


**I****5.****Heat pump connector** $(\leq 2x)$ **RFWXV15AVEB
RFWXV20AVEB**

1 2 3 4 5 6 X11M

HPc-RP

14 20 13

**2UV****6.****RoCon BM2C****Power surge
category III****V3****1 ~ 230V****Fuse 16A****L****N****RCD (FI)****RoCon BM2C****J6****J3****J16**

**II****5.****Heat pump convector****RFWXV15AVEB
RFWXV20AVEB**


1 2 3 4 5 6 X11M



(≥ 3x)

HPc-RP

14 20 13

2UV


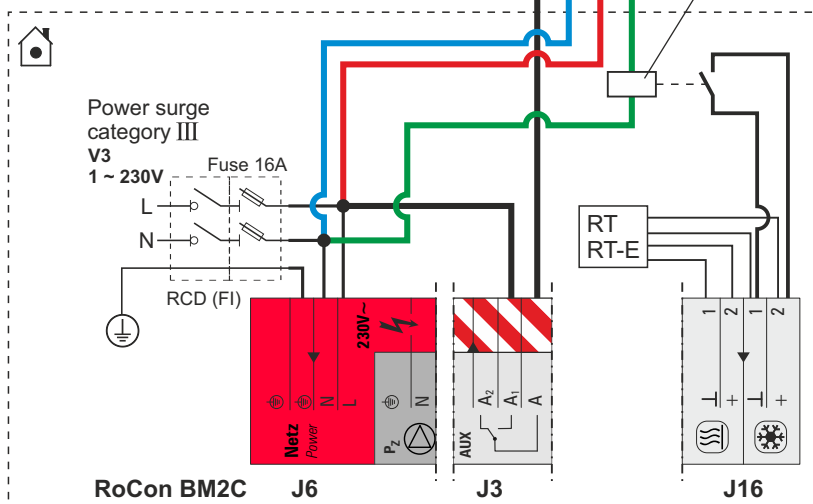
6.**RoCon BM2C**

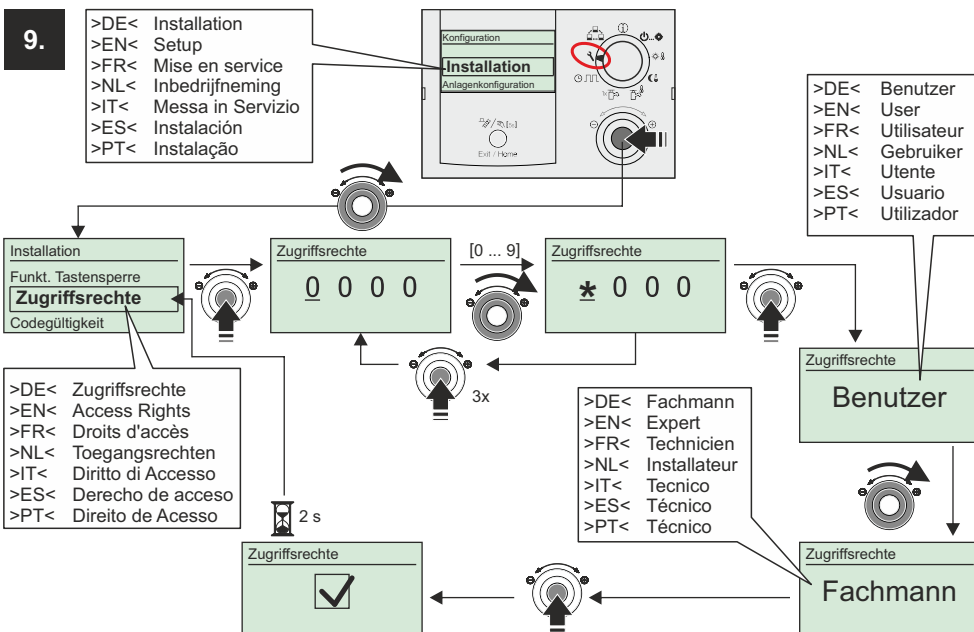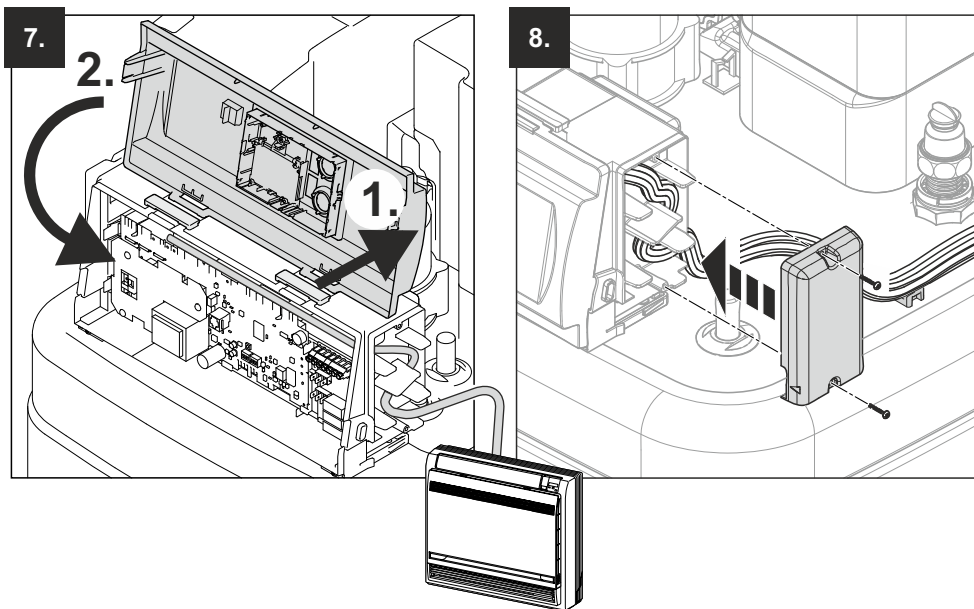




10.


>DE< Installation
>EN< Setup
>FR< Mise en service
>NL< Inbedrijfneming
>IT< Messa in Servizio
>ES< Instalación
>PT< Instalação




>DE< Interlinkfunktion
>EN< Interlink fct
>FR< Interlink fct
>NL< Interlink fct
>IT< Interlink fct
>ES< Interlink fct
>PT< Interlink fct



>DE< AUS
>EN< Off
>FR< Inactif
>NL< Uit
>IT< Off
>ES< Cerrado
>PT< Fechado





>DE< Ein
>EN< On
>FR< Actif
>NL< Aan
>IT< On
>ES< Abierto
>PT< Aberto





11.

>DE< Anlagenkonfiguration
>EN< System
>FR< Configuration du sys
>NL< Systeemconfiguratie
>IT< Config. Impianto
>ES< Config de sistema
>PT< Configuração



>DE< Sonderfkt Schalkk
>EN< AUX Fct
>FR< AUX Fct
>NL< AUX Fct
>IT< AUX Fct
>ES< AUX Fct
>PT< AUX Fct





www.daikineurope.com
www.rotex-heating.com